



Note: The Study Corridor is shown at a variable width for display purposes only. The final easement area will be within this area and may be 100 feet or less in some locations.

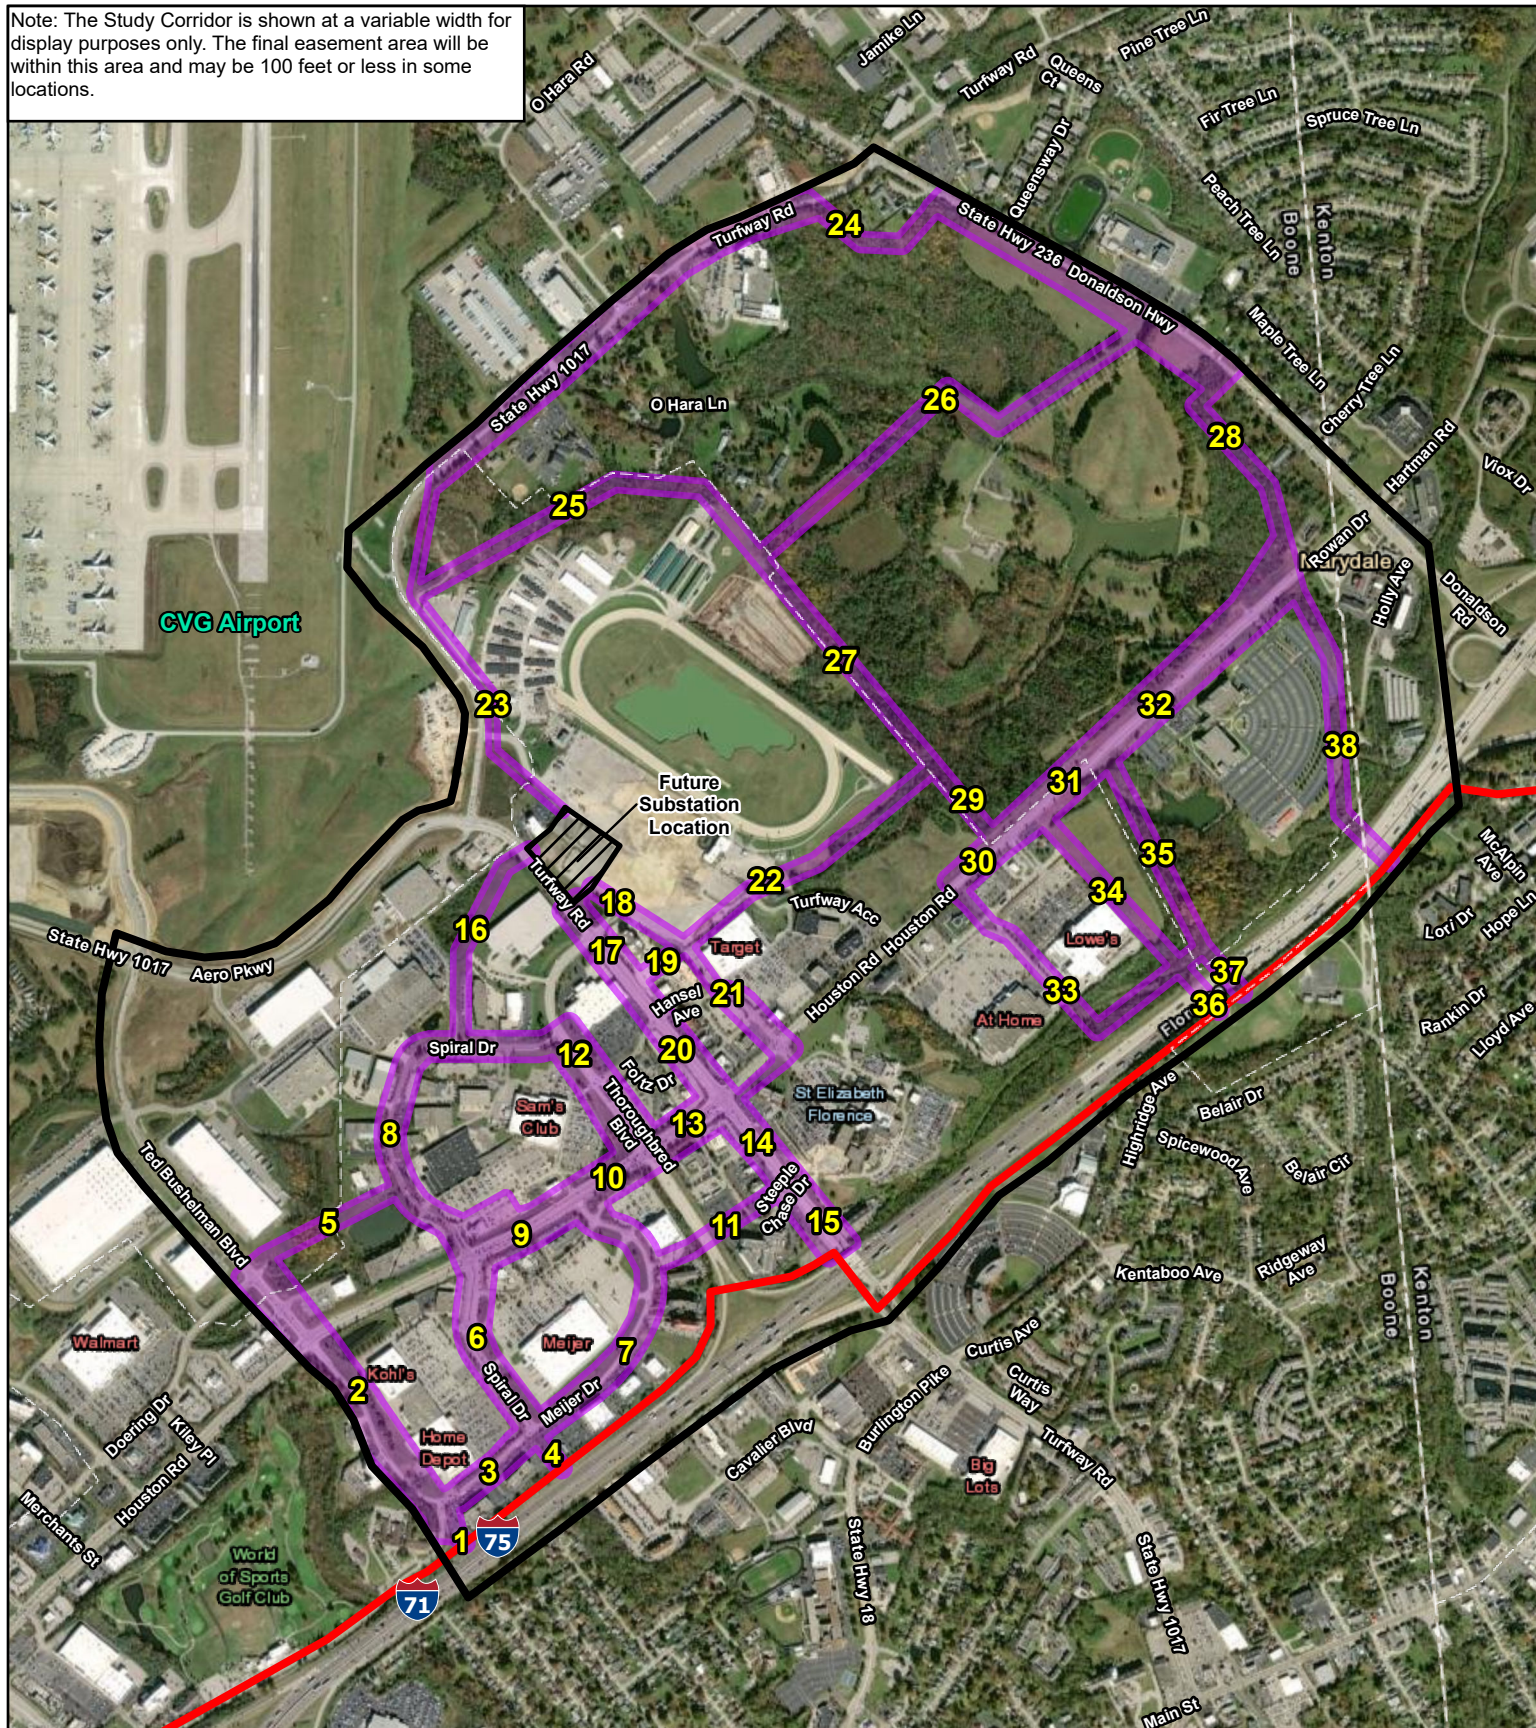

- Study Corridor
- Study Area
- Future Substation Location
- Existing Duke Energy Transmission Line
- Study Corridor Sections

0 1,000 2,000 3,000 4,000
Feet

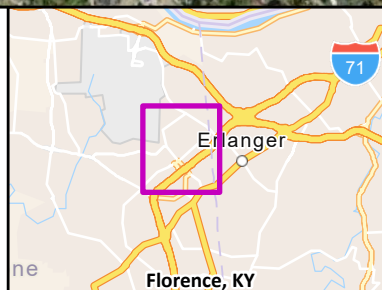

Turfway Reliability Project
Study Corridor Overview